
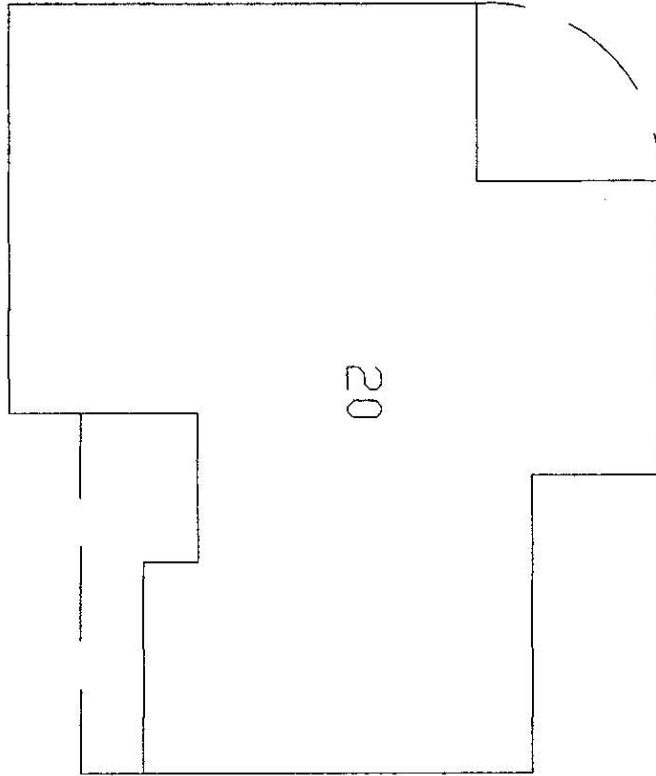


INSTALLED



20

- CLEANOUT GEN PLUG & SWITCHES
- ⊗ CHECK VALVE CORPORATION VALVE
- 3" CLEANOUT
- ① CONTROL PANEL
- ∠ DOOR
- ∠ MAIN PANEL
- 160 LB PE 1 1/4"

MORGAN POINT

REVISIONS	<i>GRINDER PUMP SKETCH</i>	TOWN OF GROTON WPCD GARY CT, GROTON
DWG: MORG20	ADDRESS: 20 MORGAN PT NOANK	OWNER:

not on acad