


INSTALLED 10/78

NOTES: USED 1 SIMPLEX PUMP. RAN IN 2-1 1/4" DISCHARGE LINES WITH CHECK VALVES IN CASE OF FUTURE EXPANSION OF 2 FAMILY HOME. WE COULD SPLIT INLET LINES AND INSTALL ANOTHER SIMPLEX PUMP. COULD NOT GET DUPLEX PUMP THROUGH DOOR OPENINGS.

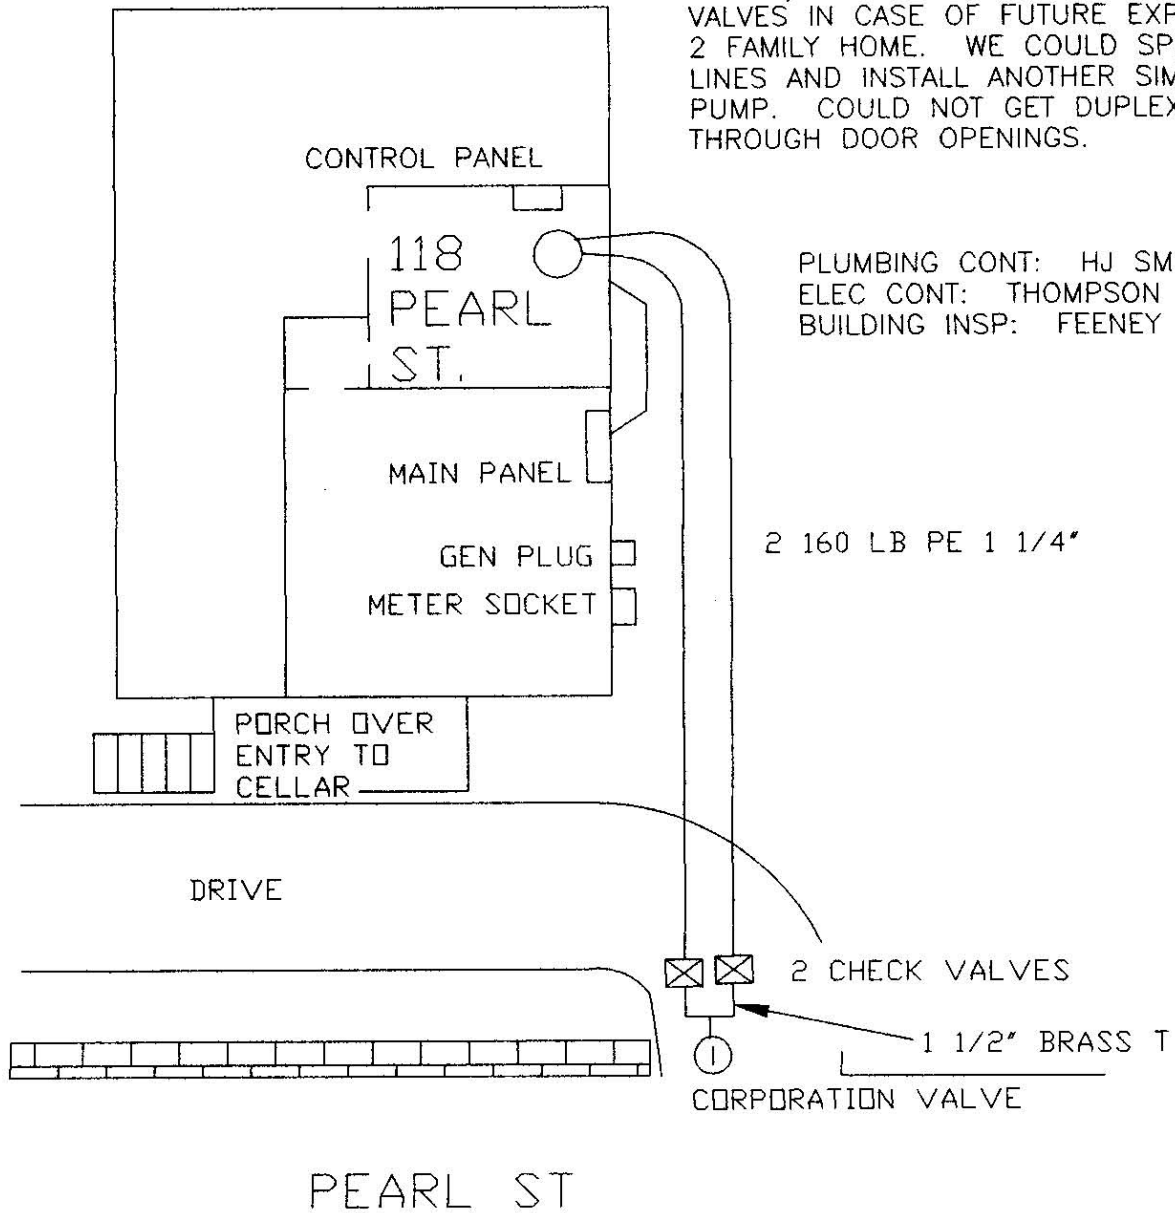

PLUMBING CONT: HJ SMITH
ELEC CONT: THOMPSON ELEC
BUILDING INSP: FEENEY

REVISIONS	<i>GRINDER PUMP SKETCH</i>	TOWN OF GROTON WPCD GARY CT, GROTON
	ADDRESS: 118 PEARL ST	
	NOANK	
DWG: PEARL118	OWNER: C. GUARIGLIA	