


INSTALLED 11/81

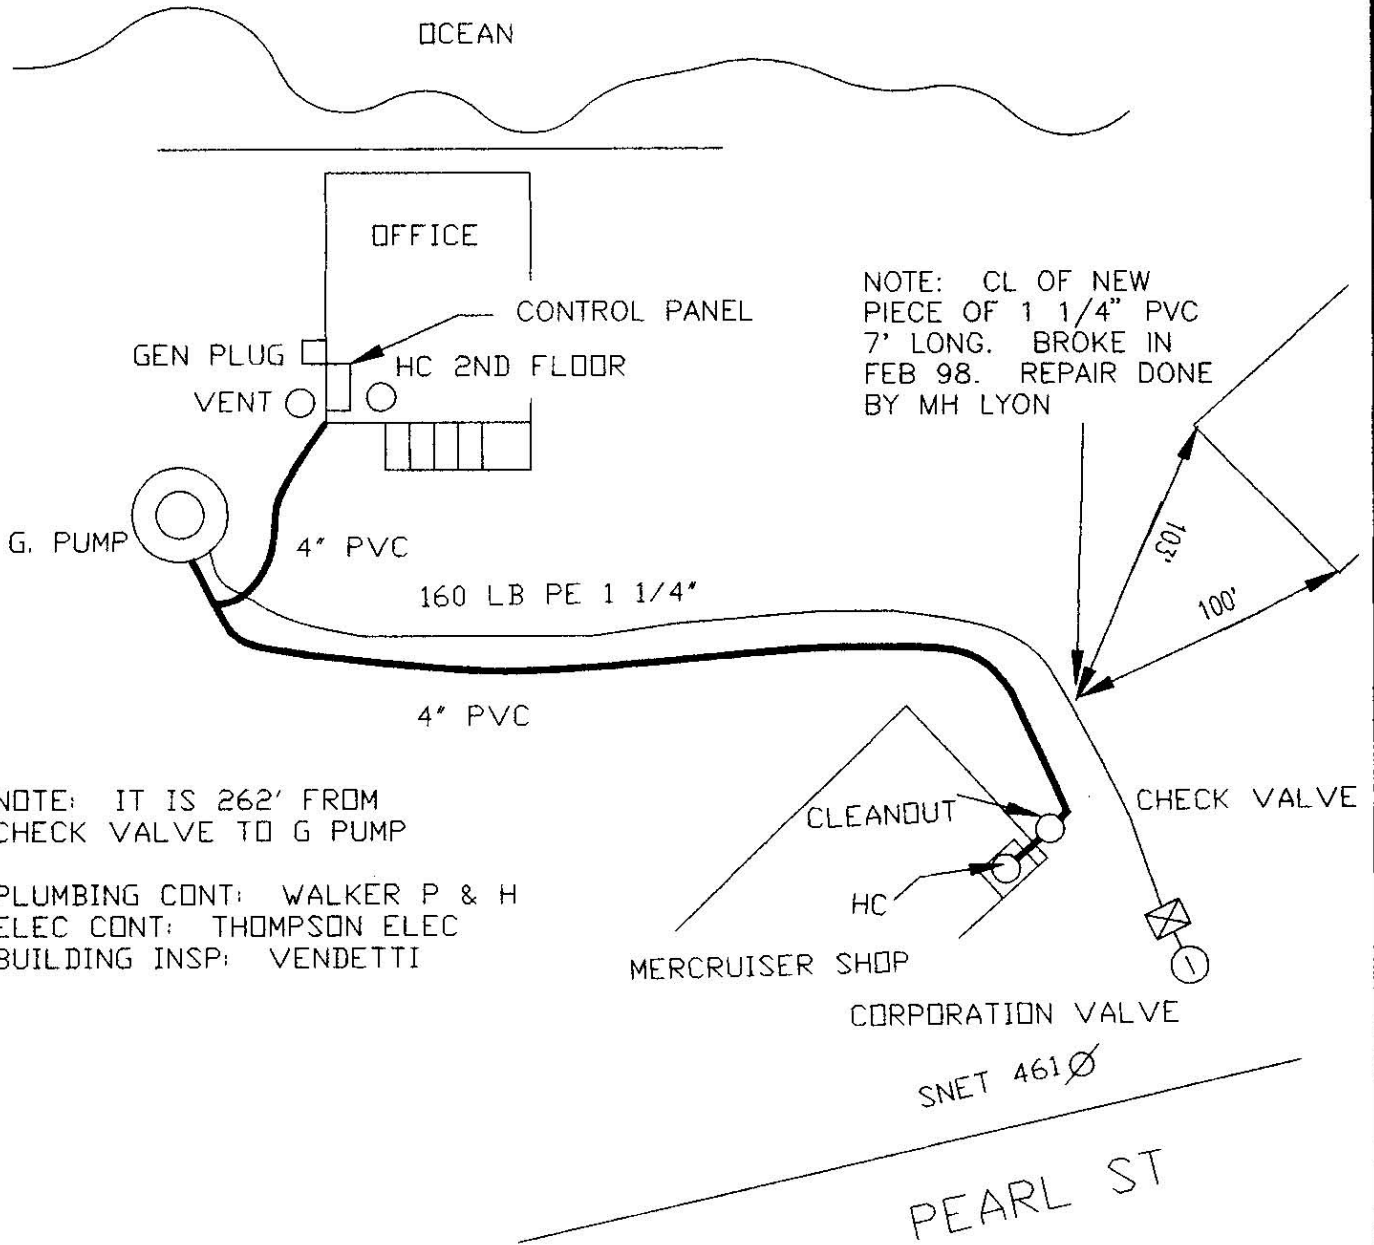

NOTE: CL OF NEW
PIECE OF 1 1/4" PVC
7' LONG. BROKE IN
FEB 98. REPAIR DONE
BY MH LYON

NOTE: IT IS 262' FROM
CHECK VALVE TO G PUMP

PLUMBING CONT: WALKER P & H
ELEC CONT: THOMPSON ELEC
BUILDING INSP: VENDETTI

CLEANOUT
HC
MERCUISER SHOP
CORPORATION VALVE
SNET 461Ø
CHECK VALVE

PEARL ST

REVISIONS	GRINDER PUMP SKETCH	TOWN OF GROTON WPCD GARY CT, GROTON
	ADDRESS: 145 PEARL ST :	OWNER: NOANK SHIPYARD, INC.
	OFFICE NOANK	
DWG: PEAR145A		